


CORONA SHIELD CONSISTS OF RING SUPPORTED AS SHOWN  
BY RODS PLACED FAR ENOUGH APART TO ALLOW SERVICING  
AND REPLACING LIGHT FIXTURE


TOP OF CORONA SHIELD SHOULD  
BE 1 FOOT ABOVE TOP OF BEACON

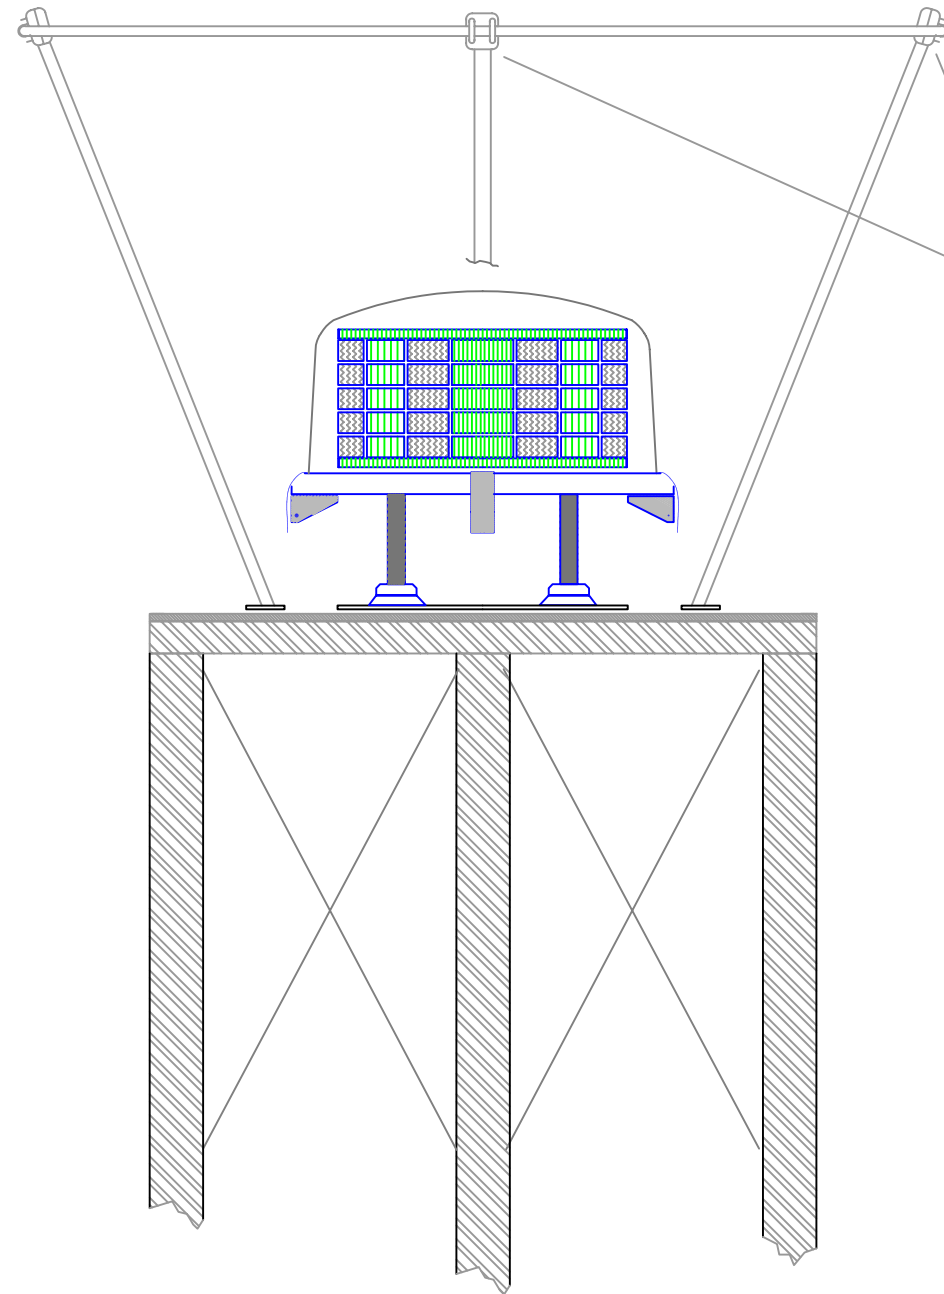

CONNECTORS HOLDING RING TO  
SUPPORT RODS SHOULD HAVE  
FLUSH MOUNTED FASTENERS  
AND HAVE ALL CORNERS ROUNDED

ATTACH CORONA SHIELD TO  
TOWER TOP PLATE AND  
INSURE SOLID ELECTRICAL CONTACT

TOP VIEW

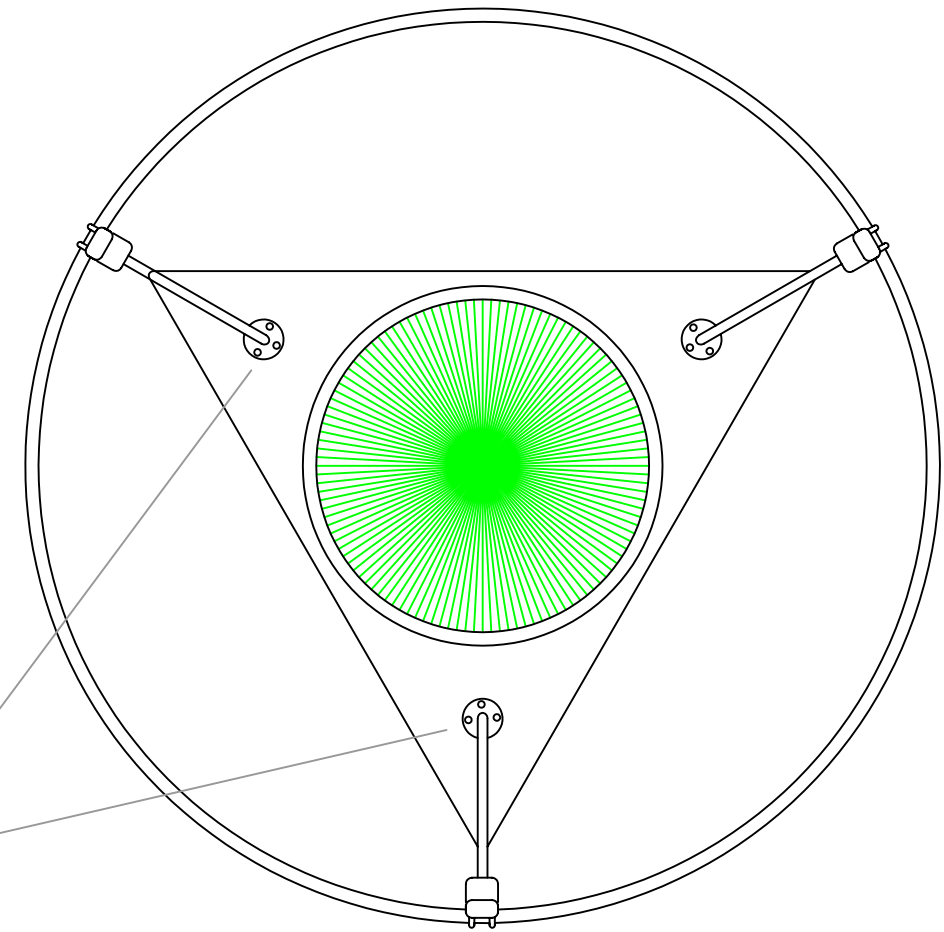

dTR / H&D  
JOINT VENTURE

CORONA SHIELD FOR TOWER LIGHTING

DRAWING BY: BOB ALLEN  
DATE: 3/2003

REVISION: 3/5/2002  
3/19/2003  
8/21/2003

DRAWING FILE:  
coronashield2.dwg

PDF FILE:  
coronashield2.pdf